


MATERIAL LIST	
#	DESCRIPTION
1	DICL PIPE RESTRAINED
2	DETECTOR CHECK (REFER TO STD. DWG. FS-DC)
3	PIPE SPOOL FLG X PLAIN END
4	CPLG BLTD
5	ADPT F X MJ W/ MEGALUG
6	FLANGE INSULATING KIT
7	CPLG BLTD INSULATING

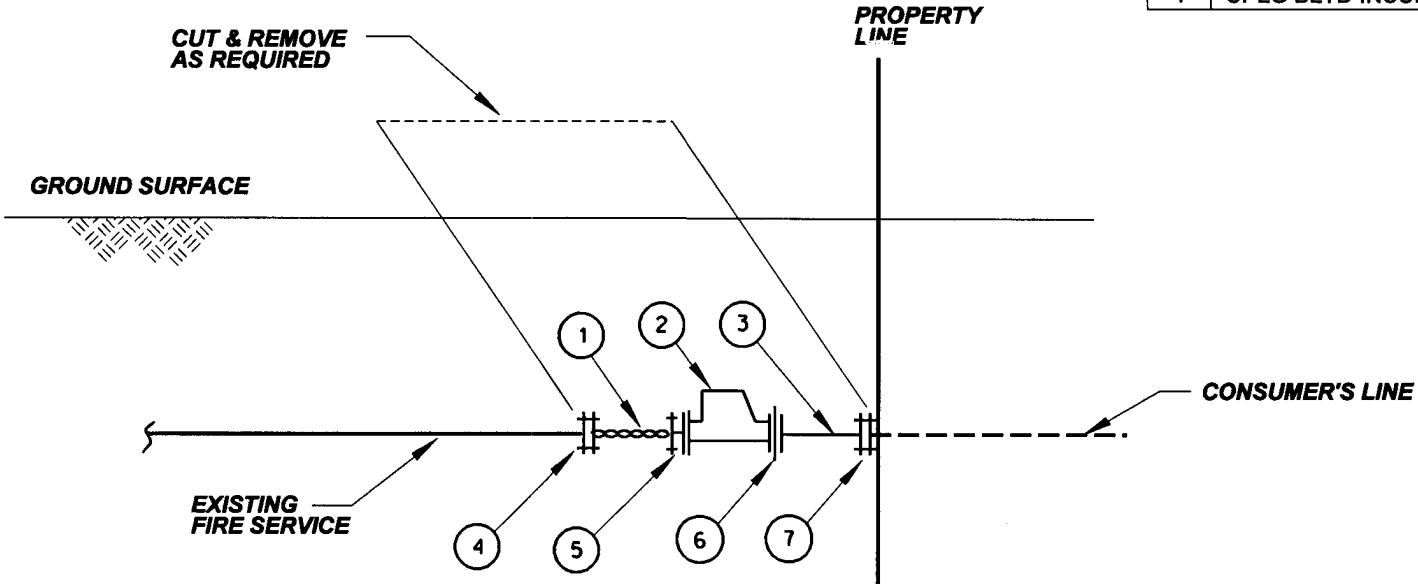

**SECTION**  
NOT TO SCALE

REVISION	DATE	CK	AP	DPS
<b>SAN JOSE WATER COMPANY</b>				
<b>DETECTOR CHECK INSTALLATION ON EXISTING PRIVATE FIRE PROTECTION SERVICE</b>				
BY	P. JOCHIM	<i>[Signature]</i>		REF. NOS.
DATE	15 NOV 04	<i>[Signature]</i>	OPERATIONS	DWG. NO.
CK	ELM	<i>[Signature]</i>	ENGINEERING	FS-AD-DC
BY	SCALE NONE	<i>[Signature]</i>	CHIEF ENGINEER	